




REAR MOUNTING SLOTS

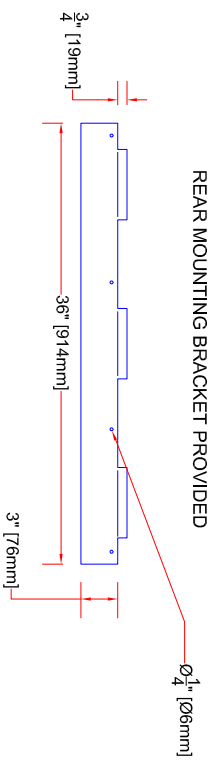


REAR MOUNTING BRACKET PROVIDED




2 anchoring brackets provided. Secure to the top of the cabinet with self drilling screws provided.

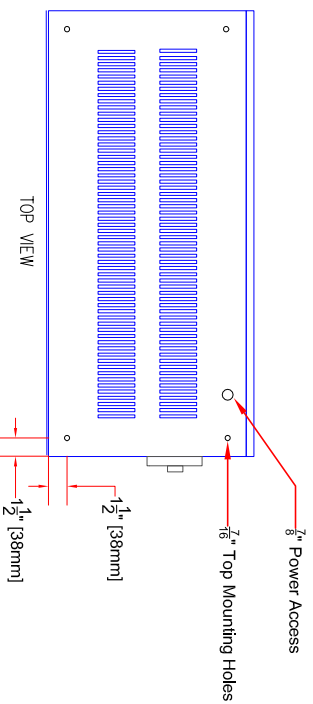

TOP VIEW




BOTTOM VIEW

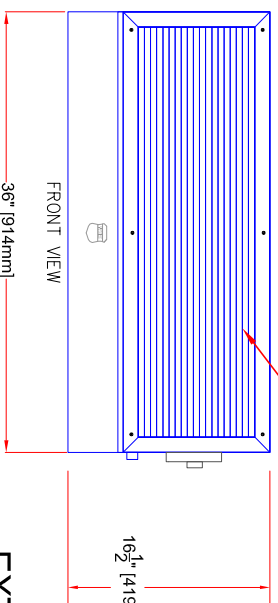

FRONT VIEW

Air Intake (Maintenance/Electrical Access)

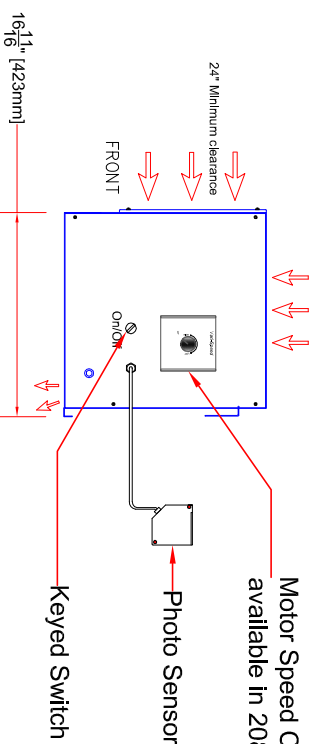

3" Minimum Clearance to ceiling  
TOP AND FRONT AIR INTAKE STANDARD

## EXTERIOR POWDER COATED TO SUIT

CSA CERTIFIED

ENERSHIELD INDUSTRIES LTD

16821-113 AVENUE

EDMONTON, ALBERTA T5M 2X2

PH (780) 482-4662 FAX (780) 482-4074

E-mail: info@enershield.ca

www.enershield.ca

### PROJECT: ENERSHIELD AIR BARRIER

PROJECT:		ENERSHIELD AIR BARRIER	
VOLTAGE	208/1/60	VOLTAGE	575/1/60
Motor (s)	TEAO	Motor (s)	TEAO
2 @ 1/2 hp = (1 hp total)		2 @ 1/2 hp = (1 hp total)	
3.5 amps ea. = 7.0 amps FLA		1.2 amps ea. = 2.4 amps FLA	
Blowers	2	DATE ORDERED	
		DATE SHIPPED	

COMFORTSHIELD

CS-36

Air Velocity (fpm)	(m/s)	4200/21.3
Air Volume (cfm)	(l/s)	4100/1935
Total hp/watts		1 hp/746W
Weight lbs/Kg		150 lbs/68 Kg

- Notes:
- 1) Electrical connections and disconnected by others.
  - 2) See owners manual for complete installation instructions.
  - 3) Installation by others. Installer is responsible for secure installation.
  - 4) Integral photo sensor has 5' of lead and is supplied with mounting bracket and reflector. Sensor is pre programmed with 15 second off delay. See owners manual for re programming the sensor.