




FRONT VIEW

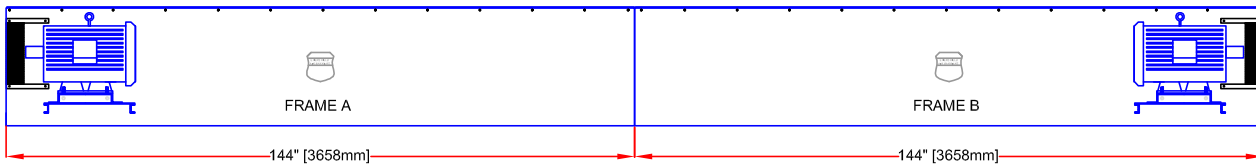


TOP VIEW

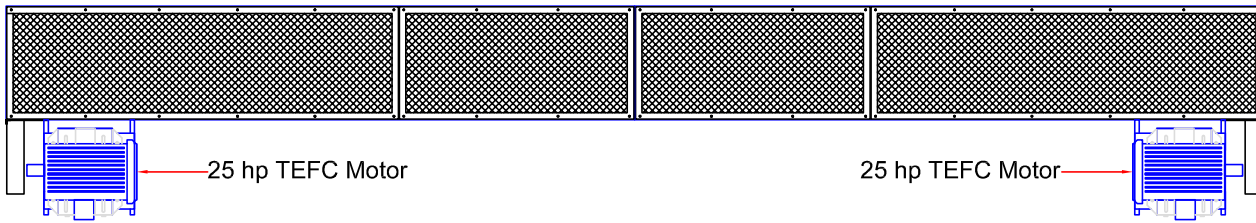

BOTTOM VIEW

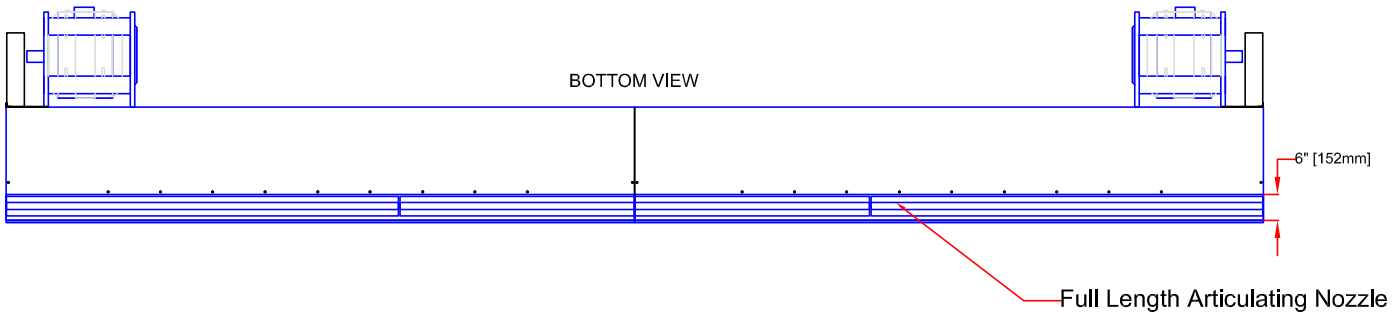

RIGHT HAND VIEW

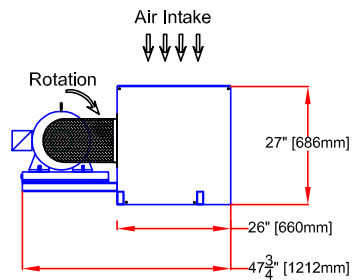

NOTES:

- 1) Installer responsible for securely and structurally mounting the air barrier.
- 2) Air Barrier is capable of spanning door without the need for intermediate support.
- 3) Top air intake is standard. Front intake available upon request.
- 4) Front motor placement is standard. Top motor placement available upon request.
- 5) Unit is to be mounted 1" above the door header.
- 6) Remote lockable NEMA 1 enclosure, motor overload protection, with external reset, Soft starter is factory set with 5 sec start up.
- 7) 2 Wall Mounts Provided.
- 8) Cabinet and accessories are powder coated ASA 49.
- 9) Electrical connection and disconnect is by others.
- 10) 4 Extendable sliders provided.

CSA & CWB CERTIFIED

<b>ENERSHIELD INDUSTRIES LTD</b> 16821-113 AVENUE EDMONTON, ALBERTA T5M 2X2 PH (780) 482-4662 FAX (780) 482-4074 E-mail: info@enershield.ca www.enershield.ca	Engineer:	MEGASHIELD		MS-288	
	Contractor:	Motor(s): 2 @ 25 hp TEFC 1800 RPM IP55		# Blowers 8	
	PROJECT:	Tag:	3 PHASE VOLTAGE	FLA	Air Velocity fpm-m/s 9900 / 50.3
			208	137.4	Air Volume CFM-l/s 57,200 / 26,994
		460	62	Total hp/Kw 50 / 37.2	
		575	50	Weight lbs/Kg 2640 / 1200	