THERMALSHIELD AIR BARRIER TS-48



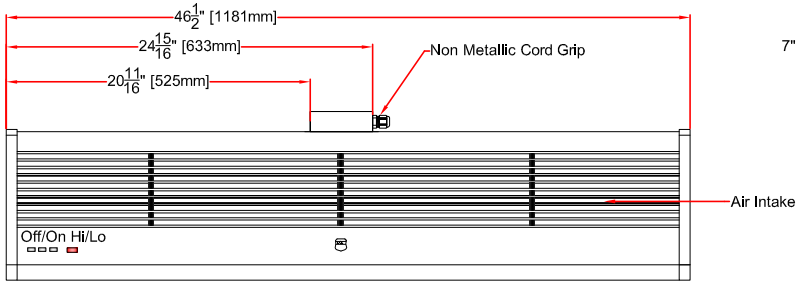

Front View

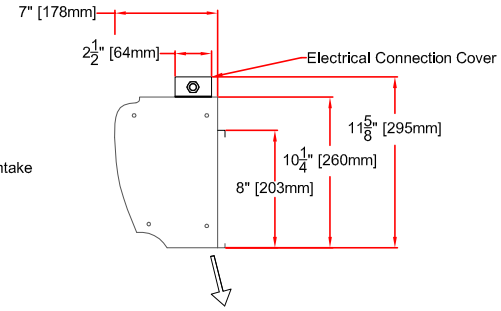

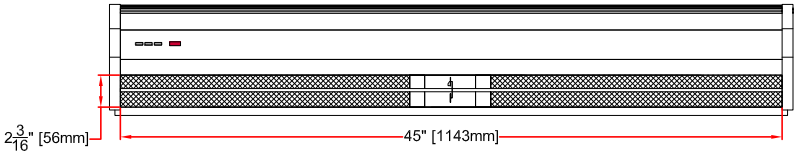

Bottom View

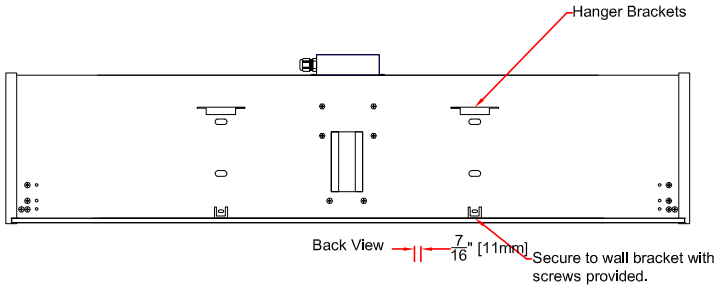

Back View

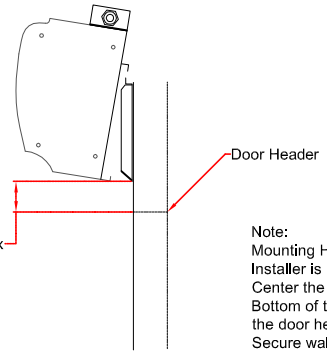

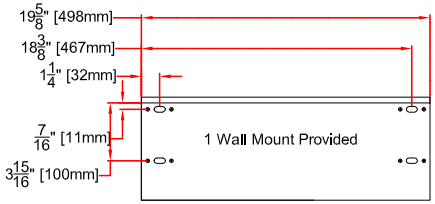



Note:
Mounting Hardware is not supplied.
Installer is responsible for ensuring a sound installation.
Center the wall bracket on the door opening.
Bottom of the wall bracket is to be a Max of 2" higher than the door header.
Secure wall bracket to wall using the appropriate means.
Adjust the diffuser to direct the air stream 5 degrees towards the outside of the building.
Unit is equipped with a 3 min off delay timer to cool down the heat coil.
Neutral Line Required

Remote Controllable
Color: Aluminum with Black

ENERSHIELD INDUSTRIES LTD
16821-113 AVENUE
EDMONTON, ALBERTA T5M 2X2
PH (780) 482-4662 FAX (780) 482-4074
E-mail: info@enershield.ca
www.enershield.ca

	HEATER		CFM			FPM		dB		MOTOR	WEIGHT
MODEL	Kw	VOLTAGE	HIGH	LOW	FLA	HIGH	LOW	HIGH	LOW		
TS-48	8	220 3 Phase	940	850	21.8	1870	1670	57	55	1 @ 60W	17 Kg